

NOROXYCDIFF®

CLEANER • DISINFECTANT • FOOD CONTACT SURFACE SANITIZER • VIRUCIDE*

DIRECTIONS OF USE

Read the Noroxycdiff label for handling instructions.

Take care not to drop, puncture, or spill concentrated liquid.


PUT ON GLOVES/EYEWEAR



Noroxycdiff's Activation Instructions

Activation of Noroxycdiff's occurs by pouring the entire contents of the Noroxycdiff 4 fl. oz. bottle in a gallon of Water to achieve a 99:1 mixed ratio and agitating the combined solution for 15 seconds. Date and affix the Noroxycdiff® RTU ready-to-use post-activation container.


1

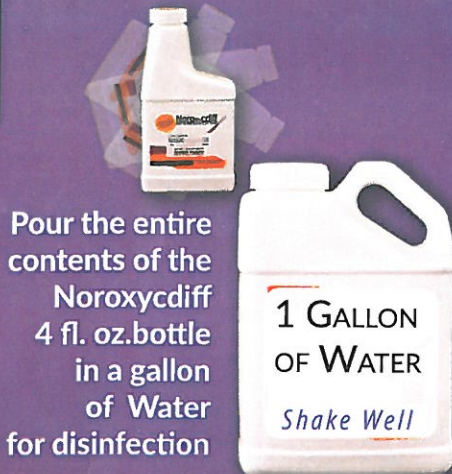

Pour the entire contents of the Noroxycdiff 4 fl. oz. bottle in a gallon of Water for disinfection


1 GALLON OF WATER
Shake Well

2

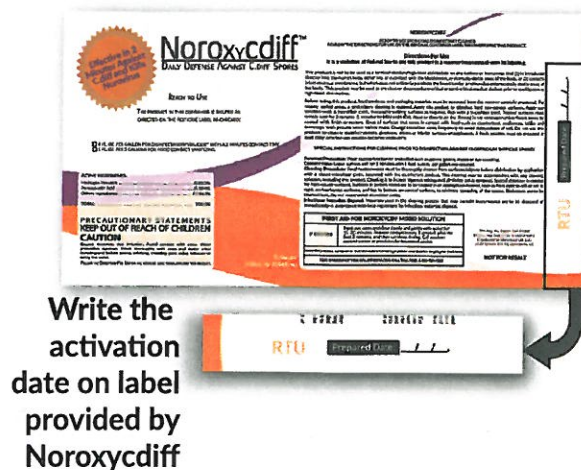

Write the activation date on label provided by Noroxycdiff


3

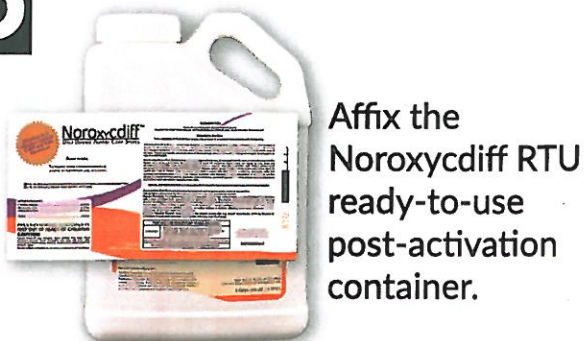

Affix the Noroxycdiff RTU ready-to-use post-activation container.

4

Apply the Ready to Use label provided to the end-user container. Follow label guidelines for disinfection cleaning with Peroxyacetic/Peroxide product.

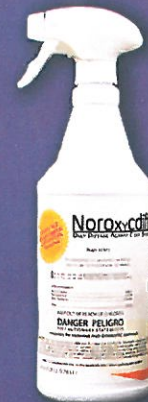

FOR EMERGENCY MEDICAL INFORMATION CALL TOLL FREE 1-800-424-9300

NOROXYCDIFF™

CLEANER • DISINFECTANT • FOOD
CONTACT SURFACE SANITIZER • VIRUCIDE*

Cleaning & Disinfecting

For *C. difficile* Spores and Other Multi-Drug Resistant Organisms

Cleaning and Disinfecting Process

Recommendation:

Caution: When cleaning and disinfecting a patient's room or bathroom that is contaminated with *C. difficile* spores use Noroxycdiff and follow these practices:

1. Wear all PPE (Personal Protective Equipment)
2. Ensure proper ventilation
3. Ensure patient safety
4. Ensure staff and visitor safety
5. Use disposable items when possible
6. Disinfect all equipment after use
7. Allow proper dwell time
8. Wash hands using approved healthcare facility procedures
9. Because Noroxycdiff doesn't leave behind residue there is no need to rinse the surface. Follow the manufacture's instructions on the bottle label.

Cleaning Process for Occupied and Discharge Patient Rooms Contaminated with *C. difficile* Spores (MDRO)

Note: Place environmental service cart outside of patient room. Make sure that the cart doesn't block the corridor.

- Use proper PPE.
- Place a "Wet Floor" sign at the entrance of the patient's room.
- Use proper dwell times as stated on the manufacture's label.
- High dusting vents and ledges using a high duster. This procedure will be performed using the "Wet Method and at Discharge."
- Clean sink using Noroxycdiff disinfectant cleaner and a clean microfiber cloth.
- Refill dispensers.
- Carefully remove soiled linen and place in the proper linen bag.
- Clean entire patient bed using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Clean over the bed table and night stand using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Clean and disinfect counter top using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Clean and disinfect phones, cords, call buttons, and TV remote controls using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Remove litter.
- Remove medical waste.
- Empty trash receptacles.
- Clean and disinfect trash receptacles using a wet clean microfiber cloth with Noroxycdiff sporicidal disinfectant cleaner.
- Remove and replace sharps containers when $\frac{3}{4}$ full, or when needed.
- Spot walls using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Clean high-touch areas such as switches and handles using Noroxycdiff sporicidal disinfectant cleaner and a clean microfiber cloth.
- Dust mop floors using a dry clean microfiber dry pad, or vacuum.